



Certified ISO 9001:2015

سجل تجاري : 4031047494

ترخيص بلدية : 440310730428

الدفاع المدني : 44 - 001079262 - 1

ترخيص صناعي : 4750

تصريح بيئي : 5336

شركة مصنع مبارك صالح للصناعة

بلوك اسمنت - بركاني - بردورات

مصنع المدينة سابقاً

مكة المكرمة - خط الخواجات - بجوار شركة كرا

MUBLUK225@GMAIL.COM

050 550 67 99

056 975 64 01

012 55 815 03



Mubarak Salih Factory Company
for Industry



شركة مصنع مبارك صالح للصناعة

Mubarak Salih Factory Company for Industry



Brief introduction to the Factory

Mubarak Saleh Saeed Volcanic and Cement Factory company is considered one of the factories established in Makah Al-Mukarramah region, in order to serve the Saudi market in the field of building and construction with the best types of building materials from concrete products The latest, most accurate and most reliable of all types of cement and volcanic blocks that are used by many giant companies in the field of building and construction, as well as our valued customers, and these products prove their quality with a certificate from the quality laboratories and certificates of thanks from the projects and giant companies That was funded in terms of quality and accuracy in appointments and delivery services that meet the customer's requests as quickly as possible and that the factory owns and, thank God, an integrated fleet of winches to meet your requirements in the field of construction and to provide products at a high level we worked on finding the latest mechanisms to operate production lines and attract hands A skilled worker.

نبذة تعريفية عن شركة المصنع

شركة مصنع مبارك صالح للصناعة للبلك البركاني والأسمنتي يعتبر من المصانع التي أنشئت في منطقة مكة المكرمة ، وذلك لخدمة السوق السعودي في مجال البناء والتشييد بأفضل مواد البناء من المنتجات الخرسانية وأحدث وأدق وأمتن جميع أنواع البلك الإسمنتي والبركاني التي تستخدمها العديد من الشركات العملاقة في مجال البناء والتشييد وكذلك عملائنا الكرام وهذه المنتجات تثبت جودتها بشهادة من مختبرات الجودة وشهادات الشكر من المشاريع والشركات العملاقة التي تم تمويلها من حيث الجودة والدقة في المواعيد وخدمات التوصيل التي تلبي للعميل طلبياته بأسرع وقت ممكن وحيث إن المصنع يمتلك و بحمد الله أسطولاً متكاملًا من الونشات لتلبية متطلباتكم في مجال الإنشاءات ولتقديم منتجات على مستوى عالي عملنا على إيجاد أحدث الآليات لتشغيل خطوط الإنتاج و استقطاب أيدي عاملة ماهرة .

البلك المفرغ : يتكون من مزيج متجانس من البطحاء والخرسان والاسمنت والتي تحتوي على تجوفين او اكثر ويستخدم البلك المفرغ في البناء وفي هياكل الجدار الداعمة والحاملة وغير الحاملة .

البلك العازل : يتكون من البوليسترين المتكامل والمتناظر في المرحلة الانتاجية (يتم وضع البوليسترين في حالة رطبة او جافة) مما يؤدي الى عزل حراري ممتاز ومتناسك هذه التقنية تستخدم بشكل واسع في اربواء والمملكة العربية السعودية وتلزم البلديات والكهرباء في المملكة لاستخدام هذا المنتج في بناء الجدران الخارجية

البلك المصمت : متين صلب ذو جودة عالية تصمد ضد مختلف الظروف الجوية مما يجعل عمره الافتراضي طويل.

Hollow concrete: It consists of a mixture of concrete, concrete, concrete and cement that contains two or more hollows. Hollow concrete is used in construction and in supportive, load-bearing and non-bearing wall structures.

Insulating board: It consists of the integrated and symmetrical polystyrene in the productive stage (the polystyrene is placed in a wet or dry condition), which leads to excellent and coherent thermal insulation. This technique is widely used in the quarters of Saudi Arabia and Saudi Arabia. Municipalities and electricity in the Kingdom are required to use this product in building external walls.

Solid block: Durable, solid, high quality that withstands various weather conditions, making its shelf life long.



منتجات البلك الخرساني

Concrete blocks products



بلك اسمنتي خرساني
عازل سندويتش أمريكي
مقاس 40×20×20



بلك عادي خرساني
7 فتحات
مقاس 40×20×20



بلك عادي خرساني
مخيش 8 فتحات
مقاس 40×20×20



بلك عادي خرساني
أنصاف مقاس 20×20×20



بلك عادي خرساني
مقاس 40×20×10



بلك عادي خرساني
مقاس 40×20×15



بلك عادي خرساني
مقاس 40×20×20



بلك خرساني 5 فتحات
مقاس 40×20×25



البلك المفرغ : يتكون من مزيج متجانس من البوزلان والاسمنت والتي تحتوي على تجوفين أو أكثر ويستخدم البلك المفرغ في البناء وفي هياكل الجدار الداعمة والحاملة وغير الحاملة .

البلك العازل : يتكون من البوليسترين المتكامل والمتناظر في المرحلة الانتاجية (يتم وضع البوليسترين في حالة رطبة او جافة) مما يؤدي الى عزل حراري ممتاز ومتناسك هذه التقنية تستخدم بشكل واسع في اربواء والمملكة العربية السعودية وتلزم البلديات والكهرباء في المملكة لاستخدام هذا المنتج في بناء الجدران الخارجية

البلك المصمت : متين صلب ذو جودة عالية تصمد ضد مختلف الظروف الجوية مما يجعل عمره الافتراضي طويل.

Hollow concrete: It consists of a homogeneous mixture of bouzlan and cement that contain two or more hollows. Hollow concrete is used in construction and in supporting, load-bearing and non-load-bearing wall structures.

Insulating board: It consists of the integrated and symmetrical polystyrene in the productive stage (the polystyrene is placed in a wet or dry condition), which leads to excellent and coherent thermal insulation. This technique is widely used in the quarters of Saudi Arabia and Saudi Arabia. Municipalities and electricity in the Kingdom are required to use this product in building external walls.

Solid block: Durable, solid, high quality that withstands various weather conditions, making its shelf life long.



مواصفات البلك البركاني

Specifications of Volcanic blocks

العزل الحراري : يتمتع البلك البركاني بمعامل توصيل حراري منخفض تبلغ قيمته (0.125) وات / متر كلفن .مما يعطي عزلاً حرارياً عالياً ويقلل الحد من انتقال الحرارة من خارج المبنى إلى داخله والعكس .


قوة التحمل : يتمتع بقوة تحمل عالية وذلك لإستخدام نظام الكبس الآلي في طريقة إنتاجه

خفة الوزن : إن الفراغات بالهواء تعمل على تخفيف الوزن في البلك البركاني ؛ حيث يبلغ وزن البلوكة الواحدة نفس وزن مثيلتها من البلك الأحمر تقريبا .


العزل الصوتي : يساعد على إمتصاص الموجات الصوتية ، مما يقلل مقدار الصدى ، تبلغ درجة إنخفاض الضجيج (3 - 6) دي بي .

سهولة التليس : فهو لا يحتاج إلى كمية طرطشة عالية ، لخشونة سطحه الذي يؤدي إلى تماسك اللياسة بشكل قوي وسريع .

مقاومة الحرائق : يساعد البلك البركاني على التخفيف من إنتقال الحرائق .

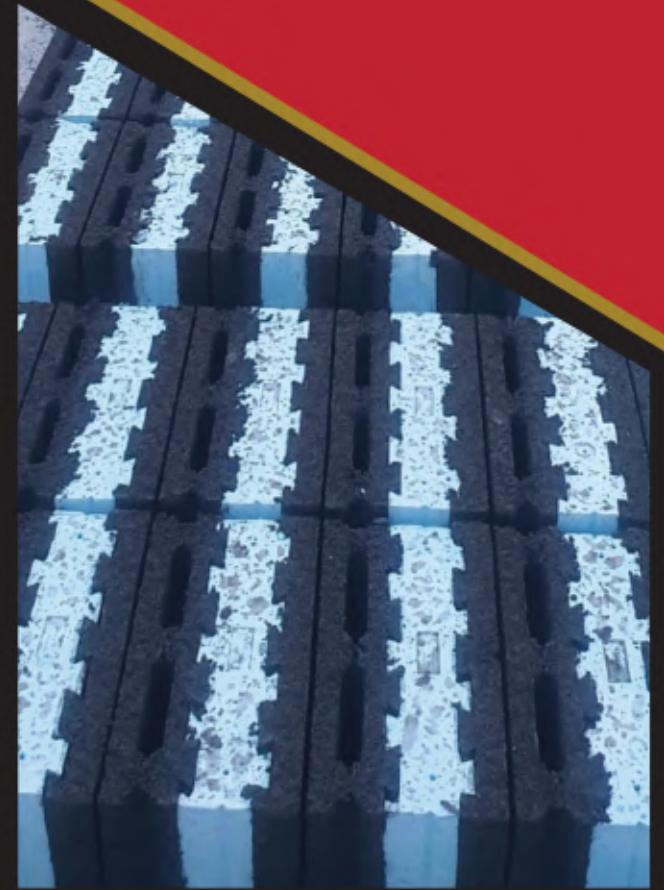


منتجات البلك البركاني Volcanic block products

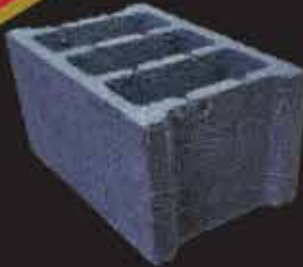

بلك بركاني 3 فتحات
مقاس 40×20×25



بلك بركاني 7 فتحات
مقاس 40×20×20

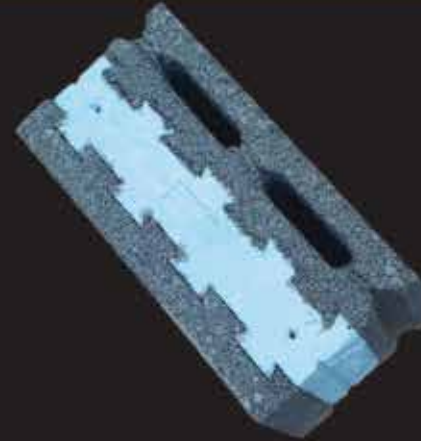

بلك بركاني
مقاس 20×40×20 عازل امريكي



بلك بركاني 5 فتحات
مقاس 40×20×30



بلك بركاني عازل شريحة
وسط جفالي
مقاس 40×20×20



بلك بركاني 3 فتحات
مقاس 40×20×10



بلك بركاني 3 فتحات
مقاس 40×20×15



بلك بركاني 3 فتحات
مقاس 40×20×20



منتجات البلك الأسمنتي Cement block products



بردورات اسمنتي
مقاس 50 × 30 × 15



بلك مصمت كامل أسمنتي
مقاس 40×20×10



بلك مصمت كامل أسمنتي
مقاس 40×20×20



بلك اسمنتي مصمت
مقاس 40×20×15



طوب خرساني اوتوماتيك
مقاس 20×10×6



بردورات اسمنتي
مقاس 50×30×10



تم توريد البلك لعدد من المشاريع الضخمة والتي تعهد المصنع بتوريد كافة متطلبات المستفيدين من البلك بمختلف انواعه وذلك عبر خدمة فريدة يوفرها المصنع تتميز بـ

- توصيل جميع انواع منتوجات المصنع مجاناً.
- احترام مواعيد التسليم المحددة مسبقاً والالتزام الدقيق بها.
- توفير اسطول ونشات لتوصيل ورفع المنتجات وفق طلب العميل .



The blocks were supplied to a number of mega projects, which the factory pledged to supply all requirements of the beneficiaries of the various types of blocks, through a unique service provided by the factory, characterized by

- Free delivery of all types of factory products.
- To respect and strictly adhere to pre-determined delivery dates.
- Provide a fleet and established to deliver and raise products according to the customer's request.





برج ميدات الغماس (العزيزة)



برج الشريف منصور (الحناوية)



الشريف يحيى (التايم تاور)



الشريف يحيى (السلوى تاور)



برج الشريف منصور (الصفاء)



برج التسليمات (ربع بخش)



الشريف يحيى (العتون تاور)





برج الشيخ الحسن
بالعزيرة




مشروع الإسكان
شركة مكيون الخمرة





السعودي بلذا
العوالي

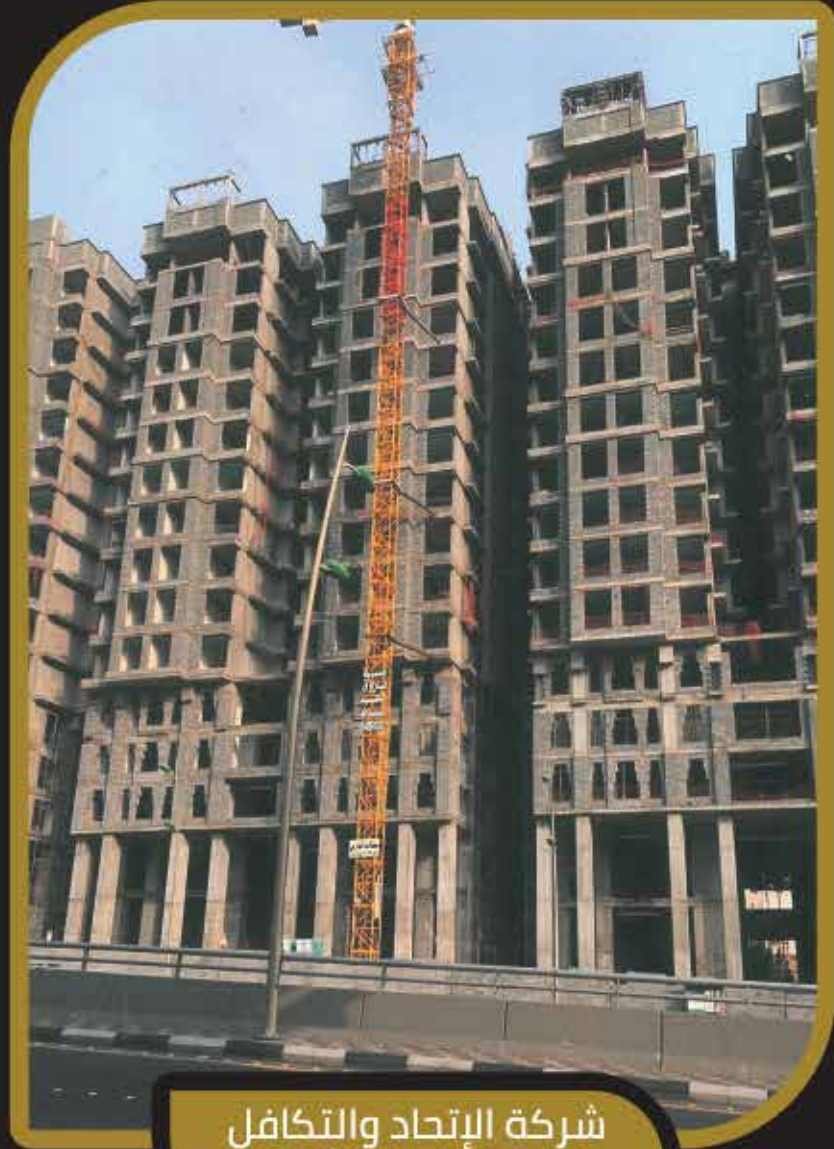


شركة الإتحاد والتكافل
مشروع البنك الأهلي





شركة مجموعة الفؤاد
شارع الحج

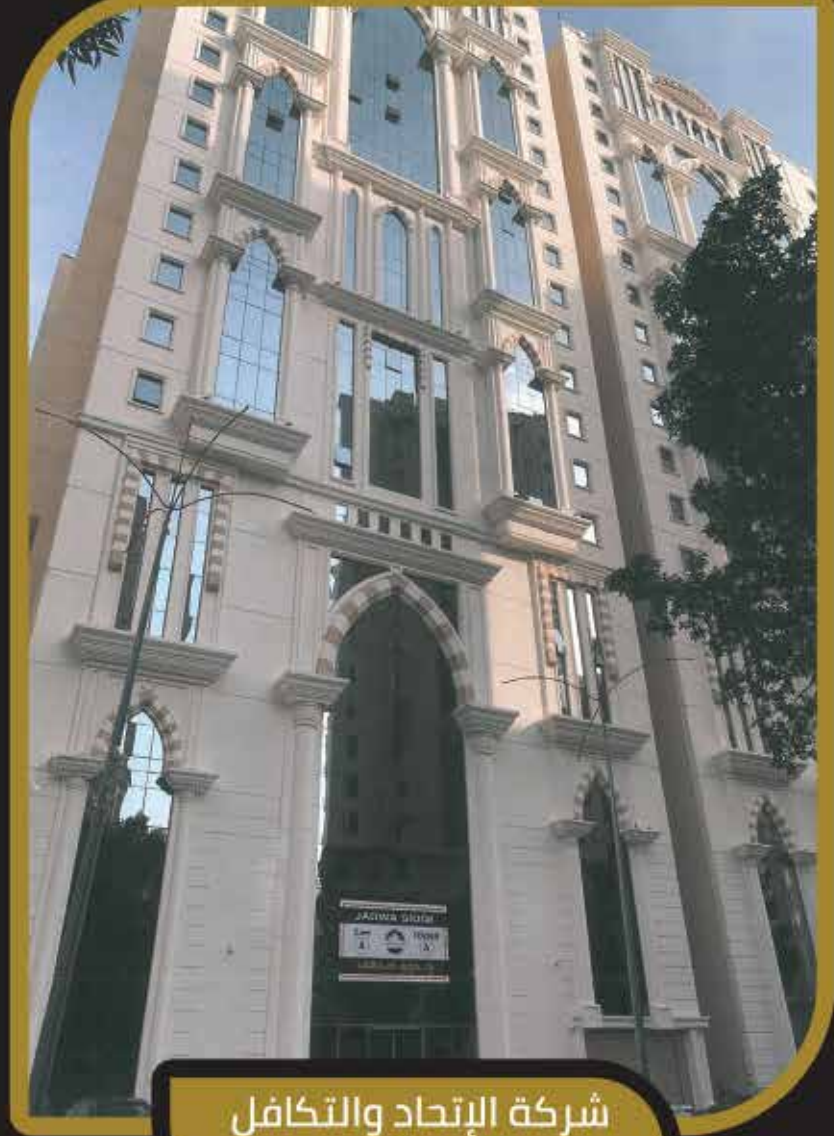

شركة الإتحاد والتكافل
صدقي





مشروع شركة افاق للاستثمار
والتطوير العقاري جده مشروع الموسى



مشروع شركة افاق للاستثمار
والتطوير العقاري مشروع الياسمين



عملائنا



شركة مصنع مبارك صالح للصناعة
Mubarak Salih Factory Company for Industry

عملائنا



الرقم: ٤٣٨/٢٦٥

التاريخ: ١٤٣٨/١٠/٢١ هـ

شهادة توريد

تشهد شركة الشريف منصور بن صالح أبو رياش للإستثمار والتنمية أن شركة
(**مصنع مبارك صالح للبلاستيك**) قطاع البلاستيك قد قامت بتوريد
البلاستيك الخرسانة والخرسانة البريكتاني المعزول لشارعها الأربعة وهي (فندق الصفا
رقم ٢١ بالشقة شارع الأمير ماجد والفندق الواقع بمكة العزيزية فندق سويسرا ستي .
الشارع العام . وعمارة الجوهرة) وأن الشركة قد قامت بواجبها في التوريد بشكل
منتظم وقد أجريت التجارب على الجودة وكانت جيدة.

وبناء لمطلبه أعطيت له هذه الشهادة.

رئيس مجلس الإدارة
الشريف منصور بن صالح أبو رياش



مكة المكرمة - العزيزية - شارع الهامية ص.ب: ٣١٦٠ - سجل تجاري: ١٠٢١ - هاتف: ٠٥١٥١١١ / ٠٥١٥١١٢ - فاكس: ٠٥١٥١١٣
Email: mansour_aborayash@hotmail.com

شهادات شكر من العملاء

١٤٣٨/١٠/٢١ هـ

المادة : مصنع مبارك صالح للبلاستيك المحترمين

السلام عليكم ورحمة الله وبركاته ،،،،

الموضوع : توريد بلاستيك مشروع أبراج ربيع بفندق مكة المكرمة

بالإشارة إلى الموضوع أعلاه والذي أتمت بتوريد البلاستيك بمختلف المقاسات وبخصوصاً البلاستيك
المعزول ومطابقتها للمواصفات القياسية المطلوبة ، نود أن نشكركم على حسن تعاملكم معنا ،
ولتزامكم بالمواعيد المحددة في توريد منتجاتكم.

كما نتطلع للتعاون معكم مستقبلاً في مشاريع أخرى متمنين لكم دوام التوفيق .

شكرين ومقدرين تعاونكم

وتقبلوا ألفتب تميئنا وتكبيرنا،،،،،

مؤسسة تسليمات للمقاولات



Kingdom of Saudi Arabia
P.O.Box 9601 Riyadh 12714
Tel: +966 11 409 2160
Fax: +966 11 401 2045
C.O. 901017545 C.R. 74202
www.alslame.com

شهادات شكر من العملاء

التاريخ : ١٤٤٨ / ٨ / ٢٠
الموافق : ٢٠١٧ / ٧ / ١٥ م



مؤسسة أحلاف البناء
للمقاولات العامة - صيانة المباني ونظافتها
وإدارة وتشغيل التجمعات السكنية

شهادة

تشهد مؤسسة أحلاف البناء للمقاولات العامة بأن السادة
مصنع مبارك صالح للبلوك قد قاموا بتوريد جميع أنواع ومقاسات البلوك
الإسمنتي لمشروعنا بمكة المكرمة والمكاتب الإدارية بمدينة مكة المكرمة والذي
يتمتع بجودة عالية .
كما نشهد بأن المصنع يتمتع بدقة عالية في مواعيد التوريد وحسن المعاملة
والجدية في العمل .

التوقيع



مكة المكرمة - العزيزية - شارع عبدالله خياط - تليفون : ٥٥٣٢٤٦٧ - ٥٥٣٢٤٦٨ - فاكس : ٥٥٣٢٤٦٥
Email : AHLAAF@HOTMAIL.COM س.ت : ٤٠٣١٠٥٧٢٥٥ - إشتراك الغرفة التجارية : ٣٣١٨٥

شهادات شكر من العملاء



Future Backpacker General Contracting Est.

التاريخ : ٢٠١٧ / ٧ / ١٥ م

شهادة

نشهد نحن مؤسسة مستقبل الرحال للمقاولات العامة بأن مصنع مبارك
صالح سعيد للبلوك الإسمنتي قام بتوريد بلوك إسمنتي وبركاني لمشروعنا
بمكة المكرمة وجده ولا يزال التعامل مستمر حتى الآن وإن جميع منتجاتهم
مطابقة للمواصفات الفنية المعتمدة من الجهات الفنية الخاصة بالمشاريع .

أصدرت هذه الشهادة بناء على طلب إدارة مصنع مبارك
صالح سعيد للبلوك دون ادنى مسؤولية على المؤسسة

تقبلو تحياتنا

المدير العام

بدرية محمد اليامي

التوقيع

المملكة العربية السعودية - مكة المكرمة - المسواقي - شارع إبراهيم الجفالي - جوال : ٥٥٥٣٢٢٩٩٣
Kingdom of Saudi Arabia - Makkah - Al Awali - Ibrahim Al Jafaly Street - Mobile : 0555532993

شهادات شكر من العملاء





مؤسسة مساراتي للمقاولات العامة Masarati General Contracting Est.

شهادة

تشهد مؤسسة مساراتي للمقاولات العامة بأن السادة شركة مصنع مبارك صالح للصناعة قد قام بي توريد جميع أنواع البلك الاسمنتي والبركالي والمصمت لمشاريعنا في الطائف (الفلل السكنية مخطط الوسام) و بمكة المكرمة (المباني الحكومية - مبنى الإدارة العامة للمجاهدين) وبجدة (المكاتب الإدارية بشوارع التحلية) والذي يتمتع بي جودة عالية .

كما نشهد بأن المصنع يتمتع بدقة عالية في مواعيد التوريد وحسن المعاملة والجديّة في العمل .

مؤسسة مساراتي
للمقاولات العامة
Masarati General Contracting Est.

التوقيع



مكة المكرمة - العوالي - شارع ابراهيم الجفالي / جوال: ٠٥٨١٠٨٥٥٥٥
Mecca - Al-Awali - Ibrahim Al-Juffali Street / Mobile: 0581085555

شهادات شكر من العملاء



مكة المكرمة في : ١٤٤٢/١٥/٢٢ هـ
الموافق : ٢٠٢١/٧/١٥ م .

إلى من يهمه الأمر

نشهد شركة مجموعة الفؤاد القابضة قسم المقاولات أن مصنع مبارك صالح للتبوك بمكة المكرمة قام بتوريد البلك الأسمنتي والبركالي لبعض مشاريعها بمكة . وقد أعطيت له هذه الشهادة بناء على طلبه ودون أدنى مسؤولية على الشركة . والله من وراء القصد .

شركة مجموعة الفؤاد القابضة - قسم المقاولات



أحد شركات مجموعة الفؤاد القابضة
Part of Al Fourad Group Holding

شهادات شكر من العملاء



شركة مصنع مبارك صالح للصناعة
Mubarak Salih Factory Company for Industry

COMPRESSIVE STRENGTH OF CEMENT BLOCK

PROJECT	مصنع بلاط		DATE	03/09/2019			
CLIENT	مصنع مبارك صالح سبيح تيلوكات والبنات والبنات		REF	SMF-3466			
SUPPLIER	مصنع مبارك صالح سبيح تيلوكات والبنات والبنات		Serial No:	1918/09/19			
LOCATION	المنطقة الحرة - المنطقة الصناعية - مكة المكرمة						
HOLLOW BLOCK DIMENSIONS:							
LENGTH	40.0 cm	NET AREA	330.00 cm ²				
HEIGHT	20.0 cm	NET VOLUME	6600.0 cm ³				
WIDTH	15.0 cm						
DATE CAST							
DATE RECEIVED	03/09/2019	WEB THICKNESS	2.5 cm				
DATE TESTED	03/09/2019	NUMBER OF CELL	3				
Test No.	Sample No.	SAMPLE DESCRIPTION	AGE (days)	WEIGHT (gm)	DENSITY (gm/cm ³)	LOAD (kN)	STRENGTH (MPa)
1	-	Cement Block	-	16,167	2.450	428.6	12.99
2	-	<< >>	-	16,346	2.477	400.0	12.12
3	-	<< >>	-	16,002	2.425	438.0	13.27
		<< Nothing follows >>			Average	422	12.79
ASTM C 129 Requirements for Non-Load Bearing Concrete Masonry Units							
		Compressive Strength based on Net Area (MPa)					
		Average of 3 units					
		Individual unit					
		3.45					
Remarks:							
1-Only Crushing.							
2-Result Relate Only to the Sample as Received.							
3-This Sample brought to Safco Laboratory of Sector.							
TEST PERFORMED BY :				CHECKED BY :			
NAME	Mosa	NAME	ENG. Mohamed Yasin				
SIGNATURE		SIGNATURE					
DATE	03/09/2019	DATE	03/09/2019				

شركة التربة والأساسات المحدودة
SOIL & FOUNDATION CO. LTD.

إختبار الجودة

Fire Resistance Rating OF HOLLOW CONCRETE MASONRY UNITS - TEST REPORT

التجربة - فوجرو - سوايمي

Client	Masrah Mubarak Saleh Masonry Blocks	Report Dated	05 June 2014
Project	Masonry Block Factory	Job No.	SA14-9027
Sample Description	Non Load Bearing Concrete Hollow Blocks (4 Cells) Bottom Surface of Units : Not Open	Lab No.	3514/1-3
Nominal Specified Dimensions	400 x 200 x 200 mm.	Supplier	Masrah Mubarak Saleh
		Sampled by	Client

Fugro-Suhaimi Ltd. (FSL) has performed standard laboratory testing on three hollow concrete block specimens delivered to FSL laboratory on 28 May 2014. The testing was carried out in accordance with the procedure outlined in ASTM C-140-08 "Standard Methods of Sampling and Testing Concrete Masonry Units and Related Units". The test result and pertinent information are as follows:

1. Dimensions					
Specimen Identification (as marked)	Average length (mm)	Average width (mm)	Average Height (mm)	Face-Shell Thickness (mm)	Web Thickness (mm)
1.	401	200	197	28	27
2.	401	200	198	27	27
3.	402	200	197	28	27
Actual Specified	400	200	200	-	-
*ASTM C-99-08 Requirement	No dimension shall differ by more than 3.2 mm from the nominal specified dimension			25 (Min.)	25 (Min.)
*ASTM C-129-06 Requirement	No dimension shall differ by more than 3.2 mm from the nominal specified dimension			13 (Min.)	-

2. Fire Resistance Rating:

The fire resistance rating period of the concrete masonry units is determined by "Calculation Method" in compliance to the Standard given in the engineering bulletin from National Concrete Masonry Association (NCMA). This calculation method determines fire resistance ratings based on the equivalent thickness of concrete masonry units and aggregate types used in their manufacture. This standard established a relationship between fire resistance rating and the equivalent thickness of concrete masonry units.

Full-Size Units (Test Specimens Nominal Size)	Equivalent Thickness (mm)	Fire Resistance Rating
Length : 400 mm Width : 200 mm Height : 200 mm	102	1.25 Hours

FUGRO-SUHAIMI LTD.
Material Division
(Mudarra P.O. Box, 17)

أوراق مختبر بك

COMPRESSIVE STRENGTH OF CEMENT BLOCK

PROJECT	عمارة بلوك			DATE	03/09/2019		
CLIENT	مصنع مبارك صالح سجاد للبلاط والبلاط والبلاط والبلاط			REF	SMF-3456		
SUPPLIER	مصنع مبارك صالح سجاد للبلاط والبلاط والبلاط والبلاط			Serial No:	1918/09/19		
LOCATION	الحيثية - مكة المكرمة - المملكة العربية السعودية						
HOLLOW BLOCK DIMENSIONS:							
LENGTH	40.0 cm	NET AREA	395.00 cm²				
HEIGHT	20.0 cm	NET VOLUME	7900.0 cm³				
WIDTH	20.0 cm						
DATE CAST							
DATE RECEIVED	03/09/2019	WEB THICKNESS	2.5 cm				
DATE TESTED	03/09/2019	NUMBER OF CELL	3				
Test No.	Sample No.	SAMPLE DESCRIPTION	AGE (days)	WEIGHT (gm)	DENSITY gm/cm³	LOAD (kN)	STRENGTH (MPa)
1	-	Cement Block	-	19,044	2.411	427.1	10.81
2	-	<< >>	-	20,131	2.548	398.0	10.08
3	-	<< >>	-	20,023	2.535	461.0	11.67
<< Nothing follows >>				Average	429	10.85	
ASTM C 129 Requirements for Non-Load Bearing Concrete Masonry Units							
				Compressive Strength based on Net Area (MPa)			
Average of 3 units				4.14			
Individual unit				3.45			
1-Only Crushing.							
Remarks: 2-Result Relate Only to the Sample as Received.							
3-This Sample brought to Safco Lab By Contractor.							
TEST PERFORMED BY :							
NAME	Mosa	CHECKED BY :	ENG Mohamed Yassin				
SIGNATURE		SIGNATURE					
DATE	03/09/2019	DATE	03/09/2019				

شركة التربة والاساس المحدودة
SOIL & FOUNDATION CO. LTD.

إختبار الجودة

COMPRESSIVE STRENGTH OF CEMENT BLOCK

PROJECT	عمارة بلوك			DATE	03/09/2019		
CLIENT	مصنع مبارك صالح سجاد للبلاط والبلاط والبلاط والبلاط			REF	SMF-3456		
SUPPLIER	مصنع مبارك صالح سجاد للبلاط والبلاط والبلاط والبلاط			Serial No:	1918/09/19		
LOCATION	الحيثية - مكة المكرمة - المملكة العربية السعودية						
HOLLOW BLOCK DIMENSIONS:							
LENGTH	40.0 cm	NET AREA	257.50 cm²				
HEIGHT	20.0 cm	NET VOLUME	5150.0 cm³				
WIDTH	10.0 cm						
DATE CAST							
DATE RECEIVED	03/09/2019	WEB THICKNESS	2.5 cm				
DATE TESTED	03/09/2019	NUMBER OF CELL	3				
Test No.	Sample No.	SAMPLE DESCRIPTION	AGE (days)	WEIGHT (gm)	DENSITY gm/cm³	LOAD (kN)	STRENGTH (MPa)
1	-	Cement Block	-	11,600	2.252	408.7	15.79
2	-	<< >>	-	11,736	2.279	427.8	16.81
3	-	<< >>	-	11,557	2.244	397.0	15.42
<< Nothing follows >>				Average	411	15.94	
ASTM C 129 Requirements for Non-Load Bearing Concrete Masonry Units							
				Compressive Strength based on Net Area (MPa)			
Average of 3 units				4.14			
Individual unit				3.45			
1-Only Crushing.							
Remarks: 2-Result Relate Only to the Sample as Received.							
3-This Sample brought to Safco Lab By Contractor.							
TEST PERFORMED BY :							
NAME	Mosa	CHECKED BY :	ENG Mohamed Yassin				
SIGNATURE		SIGNATURE					
DATE	03/09/2019	DATE	03/09/2019				

شركة التربة والاساس المحدودة
SOIL & FOUNDATION CO. LTD.

إختبار الجودة

شركة المصنع والمصنعة		COMPRESSIVE STRENGTH OF CEMENT HOLLOW BLOCK	
Job order:13957		عين قوة ضغط بلوك (ASTM: C129)	
Doc. # SAFCO-QSP-16/F02-16	Rev.# 00	Issue #: 01	Form Date: 17 July 2020
PROJECT	المشاريع ضبط الجودة		
CLIENT	شركة مصنع مبارك صالح للصناعة		
LOCATION	المنطقة الصناعية بالمنطقة الغربية السعودية		
SUPPLIER	شركة مصنع مبارك صالح للصناعة		
TEMP	26 C	HUMIDITY	34%
P.O.NO	N/A		
HOLLOW BLOCK DIMENSIONS:			
LENGTH	40.0 cm	NET AREA	366.00 cm ²
HEIGHT	20.0 cm	NET VOLUME	7900.0 cm ³
WIDTH	20.0 cm		
DATE CAST	-	Length of cell	9
DATE RECEIVED	14/05/2023	Web Thickness	2.5
DATE TESTED	14/05/2023	Number of Cell	3.0
Sample No.	SAMPLE DESCRIPTION	AGE (days)	WEIGHT (gm)
MK-13957-5-2023-S-1	CEMENT HOLLOW BLOCK (3 Cell)	-	17,640
MK-13957-5-2023-S-2		-	17,726
MK-13957-5-2023-S-3		-	17,810
- nothing follows -		Average	307.7
ASTM C 129 Requirements for Non-Load Bearing Concrete Masonry Units			
		Value	
Average of 3 units		4.54	
Individual unit		3.45	
Remarks:			
* Sample tested conforms with the requirements of ASTM C129			
*Only Crushing.			
*This Sample was collected by SUPPLIER			
*Result Relate only to the Sample as Received .			
SAMPLED BY:	Reviewed By:	CHECKED BY :	
SUPPLIER	Eng. YOUSUF ALRAZAWY (Technical Manager)	Eng. Abdel Aziz Samir	
14/05/2023	14/05/2023	SIGNATURE	

SAFCO Foundation Co. Ltd. www.safco.com

ENERGY & INDUSTRY DIVISION

إختبار الجودة

شركة المصنع والمصنعة		COMPRESSIVE STRENGTH OF CEMENT SOLID BLOCK	
Job order:13957		عين قوة ضغط بلوك (ASTM: C90)	
Doc. # SAFCO-QSP-16/F02-16	Rev.# 00	Issue #: 01	Form Date: 17 July 2020
PROJECT	المشاريع ضبط الجودة		
CLIENT	شركة مصنع مبارك صالح للصناعة		
LOCATION	المنطقة الصناعية بالمنطقة الغربية السعودية		
SUPPLIER	شركة مصنع مبارك صالح للصناعة		
TEMP	26 C	HUMIDITY	34%
P.O.NO	N/A		
HOLLOW BLOCK DIMENSIONS:			
LENGTH	40.0 cm	NET AREA	800.00 cm ²
HEIGHT	20.0 cm	NET VOLUME	16000.0 cm ³
WIDTH	20.0 cm		
DATE CAST	-	Length of cell	-
DATE RECEIVED	14/05/2023	Web Thickness	-
DATE TESTED	14/05/2023	Number of Cell	-
Sample No.	SAMPLE DESCRIPTION	AGE (days)	WEIGHT (gm)
MK-13957-5-2023-S-1	SOLID BLOCK	-	33,850
MK-13957-5-2023-S-2		-	32,581
- nothing follows -		Average	1223.9
ASTM C 90 Requirements for Load Bearing Concrete Masonry Units			
		Value	
Average of 3 units		11.7	
Individual unit		13	
Remarks:			
* Sample tested conforms with the requirements of ASTM C90			
*Only Crushing.			
*This Sample was collected by SUPPLIER			
*Result Relate only to the Sample as Received .			
SAMPLED BY:	Reviewed By:	CHECKED BY :	
SUPPLIER	Eng. YOUSUF ALRAZAWY (Technical Manager)	Eng. Abdel Aziz Samir	
14/05/2023	14/05/2023	SIGNATURE	

SAFCO Foundation Co. Ltd. www.safco.com

ENERGY & INDUSTRY DIVISION

إختبار الجودة

شركة مصنع مبارك صالح للصناعة SOL & FOUNDATION CO. LTD.		COMPRESSIVE STRENGTH OF CEMENT HOLLOW BLOCK تعيين قوة ضغط بلوك (ASTM: C129)				
Job order: 13957		Form Date: 17 July 2020				
Doc. # SAFCO-QSP-16/F02-16		Rev. # 00	Issue #: 01			
PROJECT	المشاريع ضبط الجودة					
CLIENT	شركة مصنع مبارك صالح للصناعة					
LOCATION	الحيادية مكة المكرمة المملكة العربية السعودية					
SUPPLIER	شركة مصنع مبارك صالح للصناعة					
TEST DATE	14/05/2023					
REF	MK-SMF-3911					
MK-13957-S-2023		Received Date: 14/5/2023				
TEMP	26 C	HUMIDITY	34%	P.O.NO	N/A	
HOLLOW BLOCK DIMENSIONS:						
LENGTH	40.0 cm	NET AREA	400.00 cm ²			
HEIGHT	20.0 cm	NET VOLUME	4000.0 cm ³			
WIDTH	10.0 cm					
DATE CAST	-	Length of cell	10			
DATE RECEIVED	14/05/2023	Web Thickness	2.5			
DATE TESTED	14/05/2023	Number of Cell	3.0			
Sample No.	SAMPLE DESCRIPTION	AGE (days)	WEIGHT (g)	DENSITY (g/cm ³)	LOAD (N)	STRENGTH (MPa)
MK-13957-S-2023-S-1	CEMENT HOLLOW BLOCK (3 Cell)	-	11,268	2.502	306.2	6.80
MK-13957-S-2023-S-2		-	11,316	2.515	271.6	6.04
MK-13957-S-2023-S-3		-	11,217	2.493	326.2	7.25
- nothing follows -			Average	301.3	6.70	
ASTM C 129 Requirements for Non-Load Bearing Concrete Masonry Units						
		Value				
Average of 3 units		4.14				
Individual unit		3.45				
Remarks: * Sample tested conforms with the requirements of ASTM C129 * Only Crushing. * This Sample was collected by SUPPLIER * Result Relate only to the Sample as Received.						
SAMPLED BY:	Reviewed By:	CHECKED BY:				
SUPPLIER	Eng. YOUSUF ALKADHAMI (Technical Manager)	Eng. Abdel Aziz Samir				
14/05/2023	14/05/2023	SIGNATURE				

Sol & Foundation Co. Ltd. 00902000000000

ENERGY & INDUSTRY DIVISION

إختبار الجودة

شركة مصنع مبارك صالح للصناعة
Mubarak Salih Factory Company for Industry

شركة مصنع مبارك صالح للصناعة SOL & FOUNDATION CO. LTD.		COMPRESSIVE STRENGTH OF CEMENT HOLLOW BLOCK تعيين قوة ضغط بلوك (ASTM: C129)				
Job order: 13957		Form Date: 17 July 2020				
Doc. # SAFCO-QSP-16/F02-16		Rev. # 00	Issue #: 01			
PROJECT	المشاريع ضبط الجودة					
CLIENT	شركة مصنع مبارك صالح للصناعة					
LOCATION	الحيادية مكة المكرمة المملكة العربية السعودية					
SUPPLIER	شركة مصنع مبارك صالح للصناعة					
TEST DATE	14/05/2023					
REF	MK-SMF-3911					
MK-13957-S-2023		Received Date: 14/5/2023				
TEMP	26 C	HUMIDITY	34%	P.O.NO	N/A	
HOLLOW BLOCK DIMENSIONS:						
LENGTH	40.0 cm	NET AREA	330.00 cm ²			
HEIGHT	20.0 cm	NET VOLUME	4000.0 cm ³			
WIDTH	15.0 cm					
DATE CAST	-	Length of cell	9			
DATE RECEIVED	14/05/2023	Web Thickness	2.5			
DATE TESTED	14/05/2023	Number of Cell	3.0			
Sample No.	SAMPLE DESCRIPTION	AGE (days)	WEIGHT (g)	DENSITY (g/cm ³)	LOAD (N)	STRENGTH (MPa)
MK-13957-S-2023-S-1	CEMENT HOLLOW BLOCK (3 Cell)	-	15,670	3.166	347.6	10.53
MK-13957-S-2023-S-2		-	15,517	3.135	317.8	9.63
MK-13957-S-2023-S-3		-	15,620	3.166	380.2	11.52
- nothing follows -			Average	348.5	10.56	
ASTM C 129 Requirements for Non-Load Bearing Concrete Masonry Units						
		Value				
Average of 3 units		4.14				
Individual unit		3.45				
Remarks: * Sample tested conforms with the requirements of ASTM C129 * Only Crushing. * This Sample was collected by SUPPLIER * Result Relate only to the Sample as Received.						
SAMPLED BY:	Reviewed By:	CHECKED BY:				
SUPPLIER	Eng. YOUSUF ALKADHAMI (Technical Manager)	Eng. Abdel Aziz Samir				
14/05/2023	14/05/2023	SIGNATURE				

Sol & Foundation Co. Ltd. 00902000000000

ENERGY & INDUSTRY DIVISION

إختبار الجودة

Compressive Strength of Insulated Burkani Block

TEST REF: ASTM C 140

Project	LAB TEST MUBARK SALEH FACTORY COMP		Date Received	25 November 2024		
Client	MUBARK SALEH FACTORY COMPANY FOR INDUSTRY		Date Tested	25 November 2024		
Location	Jeddah, KSA		Date of Report	25 November 2024		
Supplier	Not Provided		Tested by	NAVEED HUSSIN		
Material	Burkani Block (40 x 20 x 20 cm) with Blue Insulation (30 cm long x 4.5 cm width)		Sample /ID No.	JD-QCS-24-07387		
Source			Job Order. No.	JD-QCO-24-01148		
Environment Condition		Amb. Temperature: 30°C		Relative Humidity: 56%		
Concrete Masonry Units Dimension						
Length	40.0 cm	Dimension of Insulation	30.0 x 4.50 cm	Area	490.00 cm ²	
Width	20.0 cm	Dimension of other hole	10.0 x 3.0 cm	Net Volume	9800.0 cm ³	
Height	20.0 cm	Number of hole	8	Gross Vol.	16000.0 cm ³	
Sample No.	Sample Description	Age (days)	Weight (gm)	Density (gm/cc ³)	Load (kN)	Strength (MPa)
1	Insulated Burkani Block (40 x 20 x 20)	-	15,320	1.563	312.9	6.39
2		-	15,375	1.569	299.8	6.12
Average			15348	1.566	306.4	6.25

ASTM C 129 Requirements for Non-Load Bearing Concrete Masonry Units

	Compressive Strength based on Net Area (MPa)
Average of 3 units	4.14
Individual unit	3.45

Remarks: Sample tested conforms with the requirements of ASTM C 129



Approved By: ELWED KARAMULLAH
Checked By: KHAUD AU



Fire Resistance of Burkani Block TEST REF: NCMA TEK

Project	LAB TEST MUBARK SALEH FACTORY COMPANY FOR INDUSTRY		Date Received	25 November 2024	
Client	MUBARK SALEH FACTORY COMPANY FOR INDUSTRY		Date Tested	25 November 2024	
Location	Jeddah, KSA		Date of Report	25 November 2024	
Supplier	Not Provided		Tested by	NAVEED HUSSIN	
Material	Burkani Block (40 x 20 x 20 cm		Sample /ID No.	JD-QCS-24-07367	
Source	Site		Job Order. No.	JD-QCO-24-01148	
Environment Cond.		Amb. Temperature: 30°C	Relative Humidity: 56%		
Masonry Unit Actual Dimension					
Length	40.0	cm	Net Area	350.00	cm ²
Height	20.0	cm	Net Volume	7000.0	cm ³
Width	20.0	cm	Gross Volume	16000.0	cm ³
% Solid	43.8	%	Equiv.Thickness= %solid x eq. Thick	87.5	mm
The fire resistance rating of the concrete masonry unit is determined by "Calculation Method" in compliance to the standard given in the Engineering Bulletin from National Masonry Association (NCMA). The calculation method determined fire resistance rating based on the equivalent thickness of concrete masonry unit and aggregates types used in their manufacture. The standard established a relationship between fire resistance rating and the equivalent thickness of concrete masonry units.					
Aggregate type used in the Concrete Masonry Units : Slag					
Sample No.	Full size Units (Test Specimen Nominal Size)		Equivalent Thickness	Fire Resistance Rating	
			mm	hours	
1	Length = 40.0 cm		87.5	2.3	
	Width = 20.0 cm				
	Height = 20.0 cm				
Average					

Remarks: Non-Load Bearing Concrete Masonry Units
Sample were delivered by client to our laboratory. Information provided by the client



Approved By: ELDAVEE KARAMULLAH
Checked By: KHALID ALI

[Signature]



"For any questions/queries/complaints about the services provided by Applus, including the content & validity of this report, please contact us at: feedback.us@applus.com"

ENHANCED SECURITY: This report shall only be considered as "valid & authentic" if it is traceable with the QR code

إختبار الجودة

Compressive Strength of Insulated Burkani Block TEST REF: ASTM C 140

Project	LAB TEST MUBARK SALEH FACTORY COMPANY FOR INDUSTRY		Date Received	25 November 2024			
Client	MUBARK SALEH FACTORY COMPANY FOR INDUSTRY		Date Tested	25 November 2024			
Location	Jeddah, KSA		Date of Report	25 November 2024			
Supplier	Not Provided		Tested by	NAVEED HUSSIN			
Material	Burkani Block (40 x 20 x 20 cm) with Blue Sandwich Insulation 7.5 cm width		Sample /ID No.	JD-QCS-24-07367			
Source			Job Order. No.	JD-QCO-24-01148			
Environment Condition		Amb. Temperature: 30°C		Relative Humidity: 56%			
Concrete Masonry Units Dimension							
Length	40.0	cm	Dimension of Insulation	40.0 x 7.50	cm		
Width	20.0	cm	Dimension of other hole	12.0 x 2.0	cm		
Height	20.0	cm	Number of hole	2			
			Gross Vol.	16000.0	cm ³		
			Net Volume	8880.0	cm ³		
			Area	444.00	cm ²		
Sample No.	Sample Description		Age (days)	Weight (gm)	Density (gm/cc ³)	Load (kN)	Strength (MPa)
1	Insulated Burkani Block (40 x 20 x 20)		-	13,095	1.475	267.7	6.03
2			-	13,090	1.530	223.7	5.04
Average				13343	1.503	245.7	5.53

ASTM C 129 Requirements for Non-Load Bearing Concrete Masonry Units

Compressive Strength based on Net Area (MPa)	
Average of 3 units	4.14
Individual unit	3.45

Remarks: Sample tested conforms with the requirements of ASTM C 129



Approved By: ELDAVEE KARAMULLAH
Checked By: KHALID ALI

[Signature]



"For any questions/queries/complaints about the services provided by Applus, including the content & validity of this report, please contact us at: feedback.us@applus.com"

ENHANCED SECURITY: This report shall only be considered as "valid & authentic" if it is traceable with the QR code

إختبار الجودة

Fire Resistance of Burkani Block TEST REF: NCMA TEK

Project	LAB TEST MUBARK SALEH FACTORY COMPANY FOR INDUSTRY	Date Received	25 November 2024
Client	MUBARK SALEH FACTORY COMPANY FOR INDUSTRY	Date Tested	25 November 2024
Location	Jeddah, KSA	Date of Report	25 November 2024
Supplier	Not Provided	Tested by	NAVEED HUSSIN
Material	Burkani Block (40 x 20 x 20 cm) with Blue Sandwich Insulation 7.5 cm width	Sample /ID No.	JD-QCS-24-07367
Source	Site	Job Order. No.	JD-QCO-24-01148
Environment Cond.	Amb. Temperature: 30°C	Relative Humidity: 56%	
Masonry Unit Actual Dimension			
Dimension of Insulation	40.0 x 7.50 cm	Net Area	444.00 cm ²
Dimension of other hole	12.0 x 2.0 cm	Net Volume	8880.0 cm ³
Number of hole	2	Gross Volume	16000.0 cm ³
% Solid	55.5 %	Equiv. Thickness *Solid x eq. Thick	111.0 mm
The fire resistance rating of the concrete masonry unit is determined by "Calculation Method" in compliance to the standard given in the Engineering Bulletin from National Masonry Association (NCMA). The calculation method determined fire resistance rating based on the equivalent thickness of concrete masonry unit and aggregates types used in their manufacture. The standard established a relationship between fire resistance rating and the equivalent thickness of concrete masonry units.			
Aggregate type used in the Concrete Masonry Units : Slag			
Sample No.	Full size Units (Test Specimen Nominal Size)	Equivalent Thickness mm	Fire Resistance Rating hours
1	Length = 40.0 cm	111.0	3.5
	Width = 20.0 cm		
	Height = 20.0 cm		
Average			

Remarks: Non-Load Bearing Concrete Masonry Units

Sample were delivered by client to our laboratory. Information provided by the Client



Approved By: ELWIB KARAMULLAH
Checked By: KHALID ALI

Handwritten signature of Elwib Karamullah



The use of Applus Arabia logo and/or name for any purpose without the written consent of Applus Arabia is strictly prohibited. This report shall only be considered as "valid & authentic" if it is traceable with the QR code.

إختبار الجودة

Fire Resistance of Burkani Block TEST REF: NCMA TEK

Project	LAB TEST MUBARK SALEH FACTORY COMPANY FOR INDUSTRY	Date Received	25 November 2024
Client	MUBARK SALEH FACTORY COMPANY FOR INDUSTRY	Date Tested	25 November 2024
Location	Jeddah, KSA	Date of Report	25 November 2024
Supplier	Not Provided	Tested by	NAVEED HUSSIN
Material	Burkani Block (40 x 20 x 20 cm) with Blue Insulation (30 cm long x 4.5 cm width)	Sample /ID No.	JD-QCS-24-07367
Source	Site	Job Order. No.	JD-QCO-24-01148
Environment Cond.	Amb. Temperature: 30°C	Relative Humidity: 56%	
Masonry Unit Actual Dimension			
Dimension of Insulation	30.0 x 5.00 cm	Net Area	490.00 cm ²
Dimension of other hole	10.0 x 9.0 cm	Net Volume	9800.0 cm ³
Number of hole	6	Gross Volume	16000.0 cm ³
% Solid	61.3 %	Equiv. Thickness *Solid x eq. Thick	122.5 mm
The fire resistance rating of the concrete masonry unit is determined by "Calculation Method" in compliance to the standard given in the Engineering Bulletin from National Masonry Association (NCMA). The calculation method determined fire resistance rating based on the equivalent thickness of concrete masonry unit and aggregates types used in their manufacture. The standard established a relationship between fire resistance rating and the equivalent thickness of concrete masonry units.			
Aggregate type used in the Concrete Masonry Units : Slag			
Sample No.	Full size Units (Test Specimen Nominal Size)	Equivalent Thickness mm	Fire Resistance Rating hours
1	Length = 40.0 cm	122.5	4.0
	Width = 20.0 cm		
	Height = 20.0 cm		
Average			

Remarks: Non-Load Bearing Concrete Masonry Units

Sample were delivered by client to our laboratory. Information provided by the Client



Approved By: ELWIB KARAMULLAH
Checked By: KHALID ALI

Handwritten signature of Elwib Karamullah



The use of Applus Arabia logo and/or name for any purpose without the written consent of Applus Arabia is strictly prohibited. This report shall only be considered as "valid & authentic" if it is traceable with the QR code.

إختبار الجودة





CERTIFICATE

*This is to Certify that the
Quality Management System*

of

Mubarak Saleh Saeed Factory for Block Volcanic & Cemented & Crubs

K.S.A – Makkah – Al-Khawaja Road – Next to the Kara Company

**has been independently assessed and is compliant
with the requirements of**

ISO 9001:2015

This Certificate is applicable to the following product or service ranges:

**Volcanic Block Production, Bozian Production of ordinary and
insulated concrete Blocks, Production of Cement tiles,
Installing thermal Insulation cork slices**

Certificate No.: SA88911A

Date of initial registration 25 June 2020
Date of this Certificate 25 June 2020
Surveillance audit on or before 24 June 2021
Recertification Due/ Certificate Expiry 24 June 2023

This Certificate is property of LMS Certification and remains valid
subject to satisfactory surveillance audits.

Paul

Director

For verification and updated information concerning the present certificate visit to www.lmscert.com
This Certificate is the property of LMS Certification Limited and shall be returned immediately when demanded.



LMS Certification Limited
35 Park Hill, Huddersfield, HD2 1QG, West Yorkshire, United Kingdom
Phone: +44 (0)1484 395094
Visit > www.lmscert.com
E-mail > info@lmscert.com



LMSKAT139Q17REV02

شهادة - ISO



This is to certify that

**Mubarak Saleh Factory for Industry Company is a one-person
company.**

Al-Khawaja Road, Makkah, Makkah, 24375, Saudi Arabia

Has been assessed to be SIRI certified

OSAKSA1727888550864

For the following scope of products Production of concrete and volcanic blocks and
curbstones in all sizes with and without insulation

Date of Assessment: 03 Oct 2024

Date of Award:

Certificate No: SIRI-CEKSA1727888550864

SIRI Emblem Score: 0.92

To verify this certificate, please visit at: verify.lncit.org



The validity of this Certificate is 2 years from the date of award.

This certificate remains the property of International Centre for Industrial Transformation and shall be returned
immediately upon request.

شهادة - SIRI

رؤية VISION
2030
المملكة العربية السعودية
KINGDOM OF SAUDI ARABIA



شركة مصنع مبارك صالح للصناعة
Mubarak Salih Factory Company for Industry

